


Basic Hydronic Underfloor

Floating Slab - STS

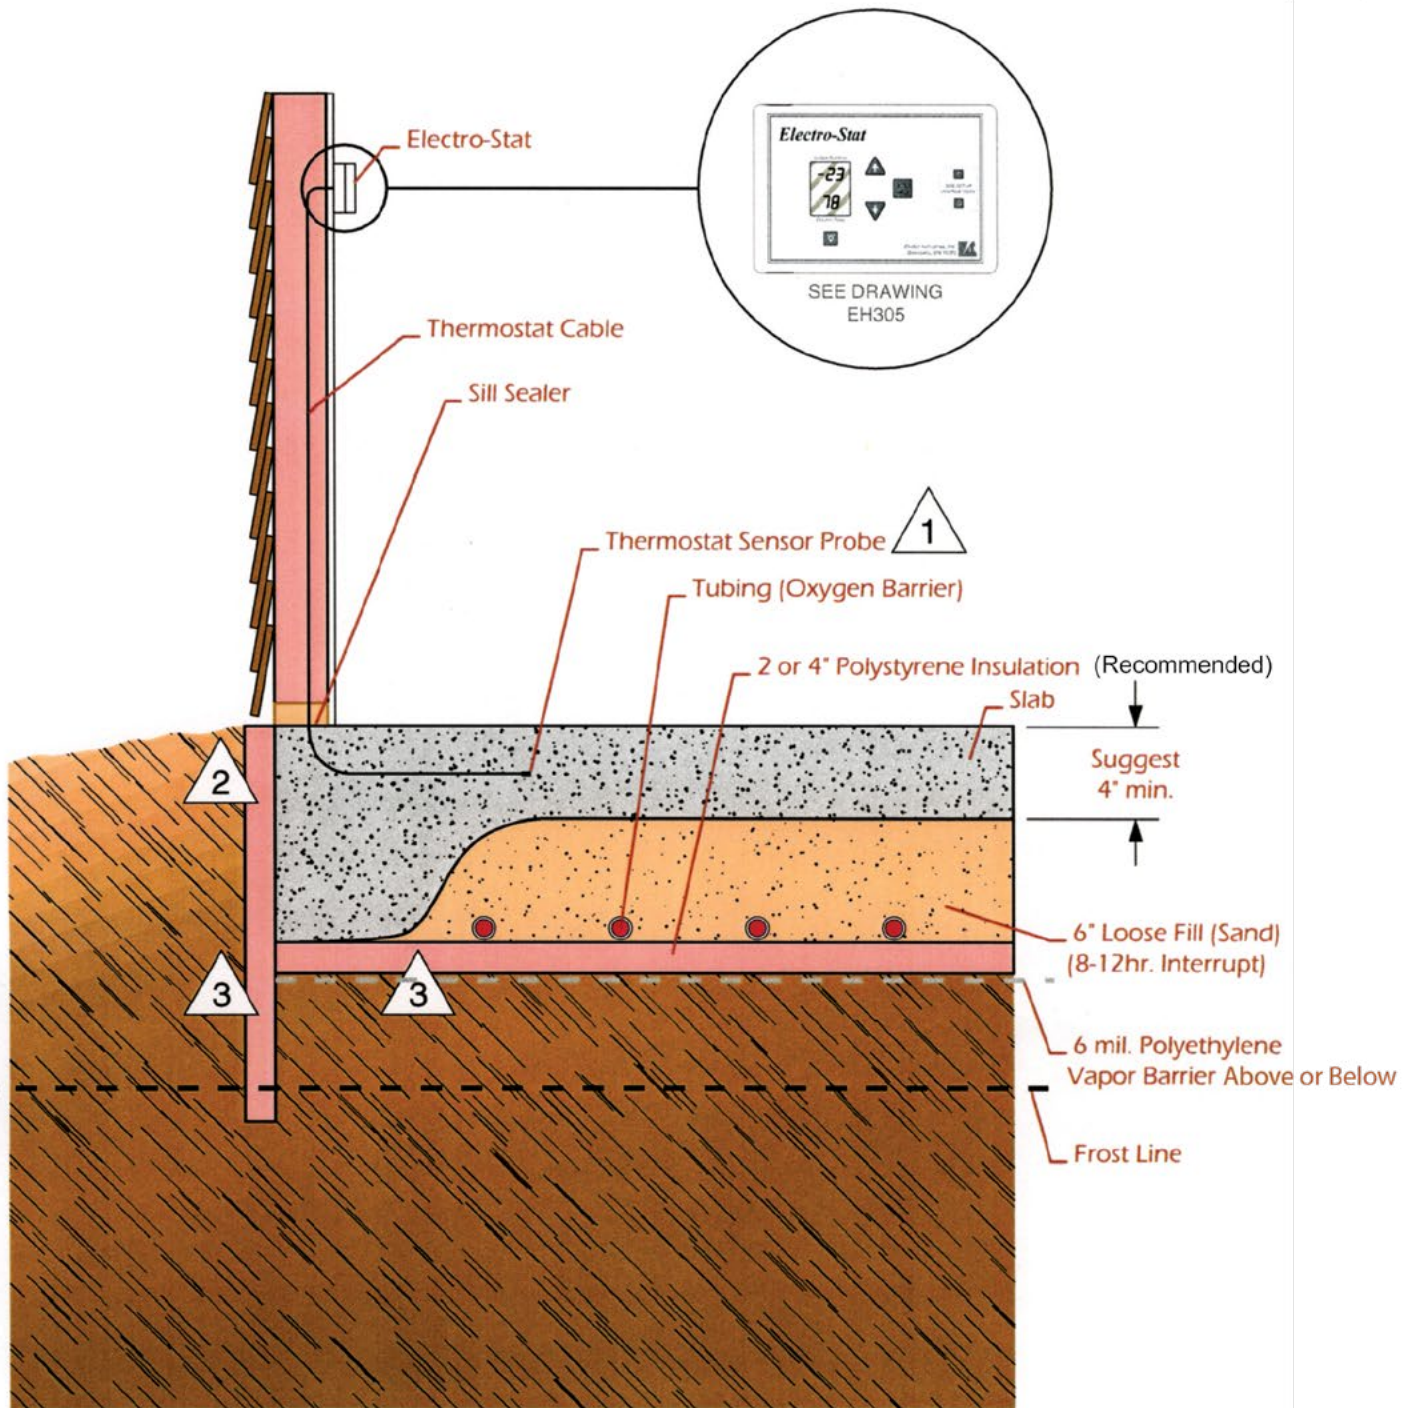

Notes:

1. Conduit required within slab, 3/4" with sweep ell.
2. If "floating slab", need screen to prevent rodent entry.
3. bottom or flat insulation board can also be extended 2'-3' outside of the slab. rodent screen becomes more difficult with this concept.